



## Overflow relief gullies and reflux valves


This technical note has been published to clarify the requirements for overflow relief gullies are not removed by the installation of a reflux valve. It contains information for the plumbing industry about the requirements and permitted omissions for overflow relief gullies.

### Overflow relief gullies

AS/NZS 3500.2:2018, clause 4.6.6.1 requires at least one overflow relief gully (ORG) be installed in a drainage system. The top of the ORG riser shall be at a minimum height of 150 mm below the overflow level of the lowest fixture or the grate of a floor waste gully. The ORG provides permanent protection from damage to the interior of a building by surcharging sewerage if the water services provider's main sewer becomes blocked. In cases where the 150 mm minimum separation cannot be achieved, a reflux valve shall be installed in addition to the ORG.

### Installation of reflux valves for sewer surcharge

The installation of a reflux valve does not omit the need to install a relief gully in a building's drainage system. Although the minimum 150 mm provision cannot be achieved, a relief gully and a reflux valve shall be installed.

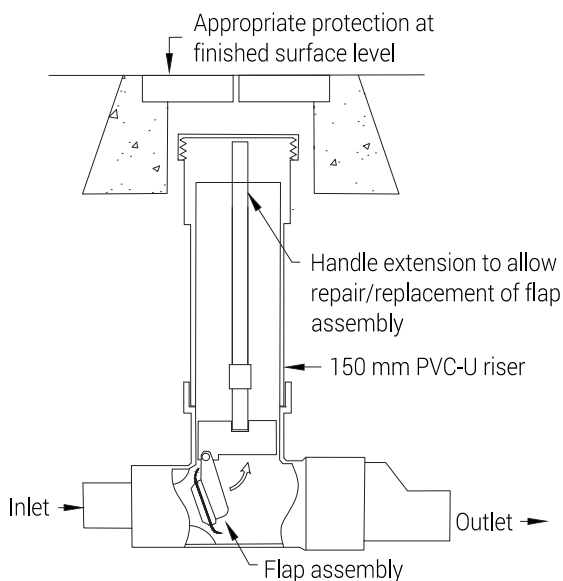

**Diagram 1:** Typical installation of a buried reflux valve

Risers serving buried reflux valves should terminate at finished surface level in an appropriate manner and with a heavy duty cover when subject to vehicular traffic and be readily visible. This alerts the maintenance plumber to the presence of a reflux valve and avoids the possibility of damage to the mechanism if rodding of the drain is carried out.

### Permitted omissions

The only situations where an ORG may be omitted are set out in AS/NZS 3500.2:2018, clause 4.6.6.2 as follows:

An overflow relief gully may be omitted where:

- the drain serves fixtures in a separate toilet block or an amenities building, which is owned or maintained by a council or similar authority, and is located in a park or reserve, provided that the floor of the building is graded to fall towards an external doorway;
- the site is entirely built on and it is not possible to locate the gully in any of the alternative locations specified in AS/NZS 3500.2:2018, clause 4.6.6.5 (figure 4.6.6.5(a) and figure 4.6.6.5(b) and the fixtures on the ground floor discharge through a reflux valve to the main sewer by gravitation.
- the lowest fixtures connected are located on floor levels that are 3 m or more above the finished surface level at the point of connection to the main sewer; or
- an alternative overflow relief point(s), equal to or the equivalent cross-section area of the drain served, is provided to the drainage systems.

## Notes:

1. Overflow relief gullies must always have sufficient ground relief. That is, making sure the surcharging sewage flows safely away and does not cause damage to property or buildings.
2. Although there are permitted omissions and alternative locations where the site is entirely built on as stated in AS/NZS 3500.2:2018, clause 4.6.6.5. It should be remembered that aesthetics and cost do not under any circumstances remove the licensed plumbing contractor's responsibility to install either a sealed internal overflow relief gully or an overflow relief gully in a specifically designed recess instead of a reflux valve.
3. In areas that may be effected by flooding there are WaterMark certified products available that may be fitted to the risers of ORGs to restrict the ingress of flood waters. These fittings are specifically designed to provide ventilation to the gully riser and fully pop out of the riser in the event of sewage surcharge.
4. The exact location of a reflux valve is to be clearly noted and shown on the required 'drainage plumbing diagram' that must be submitted to the Plumbers Licensing Board when sanitary drainage plumbing is done.
5. The risers from buried reflux valves are not accepted as raised inspection openings and therefore do not satisfy the requirements of AS/NZS 3500.2:2018, clause 4.7.4.
6. Modern building practices are making the 150 mm minimum height more difficult to attain. It is necessary for plumbers, builders, architects, owners and developers to consult before construction to allow for this requirement.
7. Depending on the topography of the building block, it may be preferable to achieve the 150 mm minimum height by locating the overflow relief gully closer to the inspection shaft with a hose tap over to maintain the water seal. Natural overflow relief is always preferable to mechanical reflux valves.
8. In an existing installation where modifications to the plumbing system or fixtures results in the 150 mm minimum height not being achieved. A reflux valve may be installed upstream from the inspection shaft and/or boundary trap. This modification to the AS/NZS 3500.2:2018, clause 4.5.3 is possible under the Regulation 49(2).
9. Licensed plumbing contractors are reminded that from the moment the drainage system is connected to the main sewer there is a risk of main sewer surcharge. This means from a certain time in construction property and building damage is possible and provision shall be made so that there is protection from main sewer surcharge.
10. When installing a reflux valve, manufacturers' specifications must be complied with.
11. AS/NZS 3500.2:2018, clause 4.6.6.7 requires the top of the ORG riser to terminate a minimum of 75 mm above the finished surface level in garden beds or grassed areas. However, in order to avoid a tripping hazard when terminated in hardstand areas such as brick paving, bitumen or concrete, the riser of an ORG may terminate level with the finished surface. When terminated within hardstand areas, the finished surface level shall be graded sufficiently away from the gully to prevent ingress of stormwater.

## Notes

The technical note series is issued by the Plumbers Licensing Board to assist the plumbing industry to comply with the Plumbers Licensing and Plumbing Standards Regulations 2000 (the Regulations) applicable to plumbing work in Western Australia.

Each technical note is to be read in conjunction with Part 6 of the Regulations that currently adopt the Plumbing Code of Australia (PCA) and the deemed to satisfy provisions of AS/NZS 3500:2018, parts 0, 1, 2 and 4 but modified in certain matters to suit the State's building approach and other local conditions.

## Copies

Technical notes are published at [www.dmirs.wa.gov.au/building-and-energy](http://www.dmirs.wa.gov.au/building-and-energy) Printed copies may be made available on request by telephone (08) 6251 1377 or email [plumbers.admin@dmirs.wa.gov.au](mailto:plumbers.admin@dmirs.wa.gov.au)

## Disclaimer

The material published by the Department of Mines, Industry Regulation and Safety (Plumbers Licensing Board) is provided voluntarily as a service to the plumbing industry. The information and advice provided is made available in good faith and is derived from sources believed to be reliable and accurate at the time of publication. The information is provided solely on the basis that readers will be responsible for making their own assessment of the matters discussed therein and are advised to verify all relevant representations, statements and information. Changes in circumstances after a document has been published may impact on the accuracy of the information. No assurance is given as to the accuracy of any information or advice contained after publication. This publication may be reproduced or copied without charge for research and educational purposes with due acknowledgement of the source.

© May 2019 Department of Mines, Industry Regulation and Safety