



Braided flexible hoses

The purpose of this technical note is to assist the plumbing industry to comply with the prescribed plumbing standards and manufacturer's installation instructions when installing braided flexible hoses.

Connection of water heaters

The Plumbers Licensing and Plumbing Standards Regulations 2000 (the Regulations), regulation 52 states that licensed plumbing contractors must ensure that materials and products shall be installed according to the manufacturer's installation specifications.

The majority of manufacturers of braided flexible hoses do not allow them to connect directly to storage water heaters. Particularly those with flexible rubber cones rather than flat fibre washers.

Restricted plumbing permit holders are reminded that under the Regulations they are not permitted to use braided flexible connectors when replacing like for like water heaters.

WaterMark certification

Whether they are suitable for connecting to water heaters or not, braided flexible hoses are required to be WaterMarked in accordance with AS 3499:2006 Water supply-flexible hose assemblies.

This standard requires each hose to be marked with 'H' or 'C' or have durable red or green indicators marking hoses for their suitability with heated and/or cold water supply.

Manufacturer's instructions

To avoid failure of braided hoses, it is essential that the manufacturer's instructions are followed during installation. Most manufacturers stipulate that the hoses should not be put under stress by being stretched, kinked or twisted. It should not be necessary to apply excessive force to the end fittings in order to obtain a water tight seal. Hoses should not be subject to contact with corrosive agents.

Hydraulic considerations

Braided flexible hoses may be adversely affected by high, fluctuating or transient pressures. Care should be taken to check these conditions before commissioning water supply systems that include braided flexible hoses.

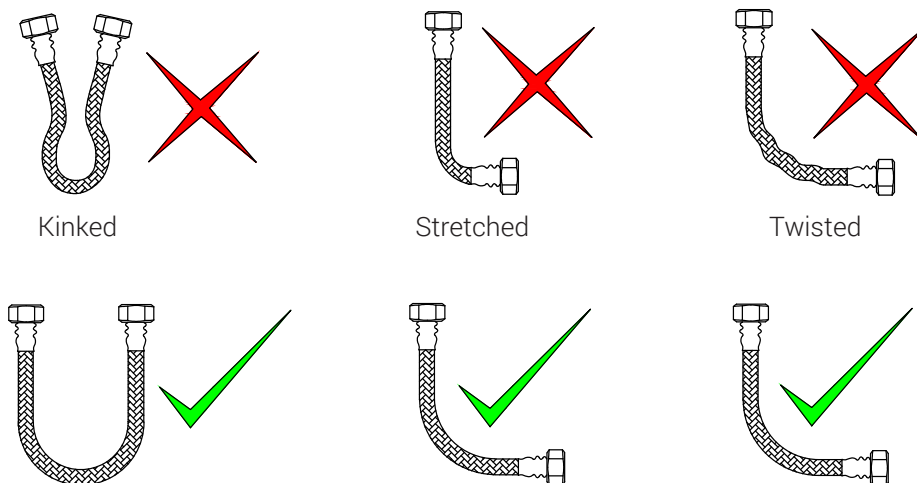


Diagram 1: Typical examples of manufacturer's installation requirements



Photo 1: Shows correctly WaterMarked and labelled braided flexible hose.



Photo 2: Shows requirements on label for correct installation of braided flexible hose. Note the WaterMark logo, applicable standard and licence number marked on the product.

Notes

The technical note series is issued by the Plumbers Licensing Board to assist the plumbing industry to comply with the Plumbers Licensing and Plumbing Standards Regulations 2000 (the Regulations) applicable to plumbing work in Western Australia.

Each technical note is to be read in conjunction with Part 6 of the Regulations that currently adopt the Plumbing Code of Australia (PCA) and the deemed to satisfy provisions of AS/NZS 3500:2018, parts 0,1, 2 and 4 but modified in certain matters to suit the State's building approach and other local conditions.

Feedback

The Plumbers Licensing Board welcomes your feedback. If you have any questions on this technical note or any suggestions on any areas of plumbing work that the technical notes should cover, please contact the Board's Senior Technical Officer on (08) 6251 1377.

Copies

Technical notes are published at www.dmirs.wa.gov.au/building-and-energy Printed copies may be made available on request by telephone (08) 6251 1377 or email plumbers.admin@dmirs.wa.gov.au

Disclaimer

The material published by the Department of Mines, Industry Regulation and Safety (Plumbers Licensing Board) is provided voluntarily as a service to the plumbing industry. The information and advice provided is made available in good faith and is derived from sources believed to be reliable and accurate at the time of publication. The information is provided solely on the basis that readers will be responsible for making their own assessment of the matters discussed therein and are advised to verify all relevant representations, statements and information. Changes in circumstances after a document has been published may impact on the accuracy of the information. No assurance is given as to the accuracy of any information or advice contained after publication. This publication may be reproduced or copied without charge for research and educational purposes with due acknowledgement of the source.

© May 2019 Department of Mines, Industry Regulation and Safety